

ASPHALT STREET


LEGEND

- | | |
|---|---|
| ① ITEM 448 1 1/4" ASPHALT CONCRETE SURFACE COURSE, TYPE 1, MEDIUM DUTY | ⑧ ITEM 659 SEEDING AND MULCHING |
| ② ITEM 448 1 3/4" ASPHALT CONCRETE INTERMEDIATE COURSE, TYPE 2, HEAVY DUTY | ⑨ ITEM 608 4" CONCRETE SIDEWALK WITH 3" COMPACTED 411 GRANULAR BASE; 6" DRIVE APPROACH AND 6" SIDEWALK BEHIND APPROACH. |
| ③ ITEM 301 7" BITUMINOUS AGGREGATE BASE | ⑩ ITEM 452 8" PLAIN PORTLAND CEMENT CONCRETE PAVEMENT WITH TYPE 2A INTEGRAL CURB |
| ④ ITEM 204 • SUBGRADE COMPACTION AND PROOF ROLLING | ⑪ ITEM 451.08 LONGITUDINAL & TRANSVERSE JOINTS; SAW CUT TRANSVERSE JOINTS ON 15' CENTERS AND AT RE-ENTRY CORNERS; SKEW JOINTS 3' FROM PERPENDICULAR WITH BACK OF CURB |
| ⑤ SUBBASE:
ASPHALT 4" NO. 1's & 2's
3" 304
CONCRETE 4" NO. 8 OR NO. 57 | ⑫ ITEM 451.15/705.04 JOINT SEALING; LONGITUDINAL, TRANSVERSE AND CURB & GUTTER JOINTS
ALTERNATE SUBGRADE PREP. (SEE NOTE 5 BELOW) |
| ⑥ ITEM 609 30" COMBINATION CURB & GUTTER; TYPE 2 MODIFIED (SEE DETAIL PV-5.0) | ⑬ ITEM 804 8" MIN SOIL-CEMENT STABILIZATION FOR ASPHALT PAVEMENT
6" MIN SOIL-CEMENT STABILIZATION FOR CONCRETE PAVEMENT |
| ⑦ ITEM 605 6" UNDERDRAINS (SEE DETAIL PV-4) | |

* WHERE GRANULAR FILL IS USED TO REPLACE SOFT SUBBASE AREAS, EXTEND CUT AND GRANULAR TO UNDERDRAIN.

- NOTES:**
1. COMPACTION OF TRENCHES IN THE RIGHT-OF-WAY IS REQUIRED FOR ALL UTILITIES.
 2. LIMESTONE SHALL BE USED FOR ALL AGGREGATE SUBBASE, FOR COARSE AGGREGATE IN ALL ASPHALT PAVEMENT AND FOR COARSE AGGREGATE IN CONCRETE.
 3. PORTLAND CEMENT FOR CONCRETE PAVEMENT SHALL BE PROPORTIONED USING OPTIONS 1 OR 2, ODOT CMS 499.04. BLAST FURNACE SLAG IS NOT PERMITTED.
 4. NO RECLAIMED PAVEMENT MATERIALS SHALL BE USED IN NEW PAVEMENT.
 5. IF SOIL-CEMENT STABILIZATION IS USED FOR SUBGRADE STABILIZATION, THE FOLLOWING MODIFIED SECTION THICKNESSES MAY BE USED:

ITEM 301	6"
SUBBASE	3" FOR CONCRETE
ITEM 452	7"

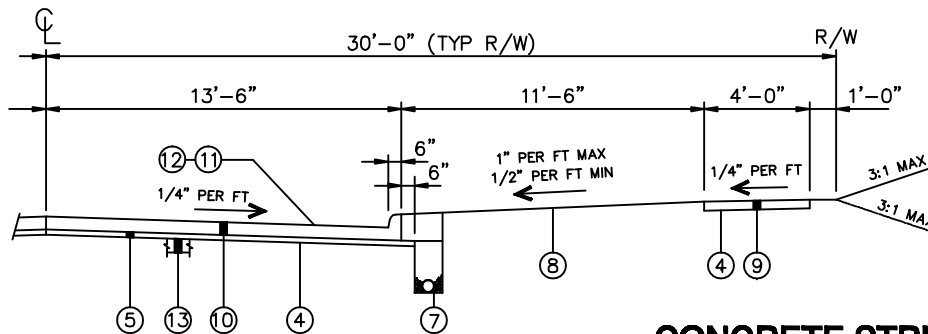

CONCRETE STREET

NOTE 1: THIS DETAIL IS VALID ONLY WHEN USED AS PRESENTED HERE, WITHOUT CHANGES, AND IN CONJUNCTION WITH ANY GENERAL NOTES AND/OR OTHER DETAILS WHICH MAY APPLY. ANY CHANGES TO THIS DETAIL SHALL FIRST BE SUBMITTED TO AND APPROVED BY THE CITY ENGINEER.

NOTE 2: BEFORE ANY EXCAVATING, CALL THE FOLLOWING NUMBERS AT LEAST 48 HOURS IN ADVANCE: O.U.P.S. @ (800) 362-2764 AND O.A.G.P.U.P.S. @ (800) 925-0988.

City of Wooster : Division of Engineering

538 N. Market Street Wooster, Ohio 44601
 Phone: (330) 263-5234 Fax: (330) 263-5247
 Joel Montgomery, P.E.
 City Engineer

NO.	DATE	REVISION	7	9/17/04	REV. ITEMS 6-13 & NOTE 2-3, ADD NOTE 4
1	7/16/01	ADDED NOTES 2 & 3	8	9/17/04	REV. TITLE FROM COMM. TO INDUSTRIAL
2	8/29/01	ADDED BUBBLE & LEADER FOR ITEM ⑫	9	6/06/05	REV. ITEMS 6 & NOTE 4, ADD NOTE 5
3	8/12/03	REVISED THICKNESS FOR ITEM ②	10	9/30/06	REV. ITEM 4 & SEAL GUTTER NO., NOTE 2
4	9/23/03	REV. ASPHALT ITEM #'S	11	10/31/08	REV. ITEM 9 & 11
5	6/01/04	REVISED ITEM ⑤	12	7/6/10	REV. NOTE 2
6	7/28/04	REVISED LEGEND AND NOTES			

TYPICAL STREET RESIDENTIAL

CAD FILE:
ENGINEERING STANDARDS/PV-1.DWG

DRWN BY: AJM	APPRD BY: EPO	ISSUE DATE: 11/06/00	SCALE: NONE
-----------------	------------------	-------------------------	----------------

SHEET:
PV-1.0